© This drawing remains the property of Renaissance Engineering Ltd. and is issued on the premise that it shall not be retained, copied, reproduced or disclosed to any other third party, either wholly or in part without prior written consent.

GENERAL NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS AND STRUCTURAL ENGINEERS CONSTRUCTION ISSUE DRAWINGS, FIRE CERTIFICATE & FIRE DRAWINGS, ALONG WITH THE CONSULTANTS MECHANICAL AND ELECTRICAL SPECIFICATIONS AND ANY OTHER DOCUMENTATION.
2. DO NOT SCALE FROM THIS DRAWING. THIS DRAWING IS REPRESENTATIVE ONLY. ALL DIMENSIONS ARE IN MILLIMETERS (mm), UNLESS OTHERWISE STATED. USE THE FIGURED DIMENSIONS WHEN SHOWN.
3. THE EXACT LOCATION OF SERVICES AND FITTINGS TO BE AGREED ON SITE WITH THE ARCHITECT AND/ OR MECHANICAL OR STRUCTURAL ENGINEER PRIOR TO THEIR INSTALLATION.
4. THE MECHANICAL AND ELECTRICAL SERVICES ARE TO BE CO-ORDINATED WITH ALL OTHER TRADES AND TO BE AGREED ON SITE PRIOR TO THEIR INSTALLATION. THE CONTRACTOR SHALL ALLOW FOR THE SETTING OUT AND INSTALLATION AROUND ALL OBSTRUCTIONS. ADDITIONAL COSTS INCURRED BY THE CONTRACTOR DUE TO THE LACK OF CO-ORDINATION WILL NOT BE ENTERTAINED.
5. CONNECTIONS TO ALL EQUIPMENT TO BE MADE BY THE CONTRACTOR.
6. FIRE/ SMOKE DAMPERS, FIRE COLLAR/ SLEEVES, INTUMESENCE PUTTY AND FIRE BARRIERS ARE TO BE INSTALLED WHERE DUCTING, PIPEWORK, CABLES, CONTAINMENT AND ANY OTHER SERVICES PASS THROUGH A FIRE WALL/ COMPARTMENT OR FLOOR.
7. ANY DISCREPANCIES BETWEEN THIS DRAWING AND ON SITE CONDITIONS MUST BE REPORTED TO RENAISSANCE ENGINEERING LTD. IMMEDIATELY. ANY CHANGES FROM THIS DESIGN DRAWING MUST BE AGREED WITH THE ENGINEER IN WRITING. A FAILURE TO GAIN THIS APPROVAL COULD LEAD TO DIFFICULTY IN APPROVING PAYMENT FOR THE VARIATION(S).
8. INSTALLATION/ CONSTRUCTION/ AS-BUILT DRAWINGS TO BE PREPARED WITH REFERENCE TO THE LATEST ARCHITECTS AND STRUCTURAL ENGINEERS CONSTRUCTION ISSUE DRAWINGS AND LATEST FIRE CERTIFICATE DRAWINGS.
9. ALL WORKS TO COMPLY WITH THE NATIONAL CODE OF PRACTICE FOR CUSTOMER INTERFACE 4th EDITION 2008.

SITE SERVICES NOTES:

- ESB 50mm DUCT (@ 600mm BFGL) (FROM MINI-PILLAR TO DWELLING)
- ESB 125mm DUCT (@ 600mm BFGL). CIRCUIT LAYOUT AND FINAL NUMBER OF DUCTS TO BE CONFIRMED BY THE ESB.
- ESB MINI PILLAR (EMP) (1000x1300x900d)
- EIR 32-50mm DUCT (@ 400mm BFGL) (FROM CHAMBER TO DWELLING)
- EIR 100mm TWIN WALL GREEN DUCT (@ 400mm BFGL)
- EIR CHAMBER (EC) (JB4 910x440x800d)
- VIRGIN MEDIA 32-50mm DUCT (@ 400mm BFGL) (FROM CHAMBER TO DWELLING)
- VIRGIN MEDIA 110mm DUCT (@ 400mm BFGL)
- VIRGIN MEDIA CHAMBER (VC) (FW3 750x600x600d)
- STREET LIGHTING 100mm DUCT (@ 600mm BFGL). CIRCUIT LAYOUT AND FINAL NUMBER OF DUCTS TO BE CONFIRMED BY THE ESB.
- STREET LIGHTING MINI PILLAR (LMP)
- PROPOSED ESB SUBSTATION - AS PER ESB LAYOUT
- 29W LUMISTREET GEN2 MICRO BGP291 DW50 LED-HB 5.2S 730, FITTINGS MOUNTED ATOP 6m POLES.

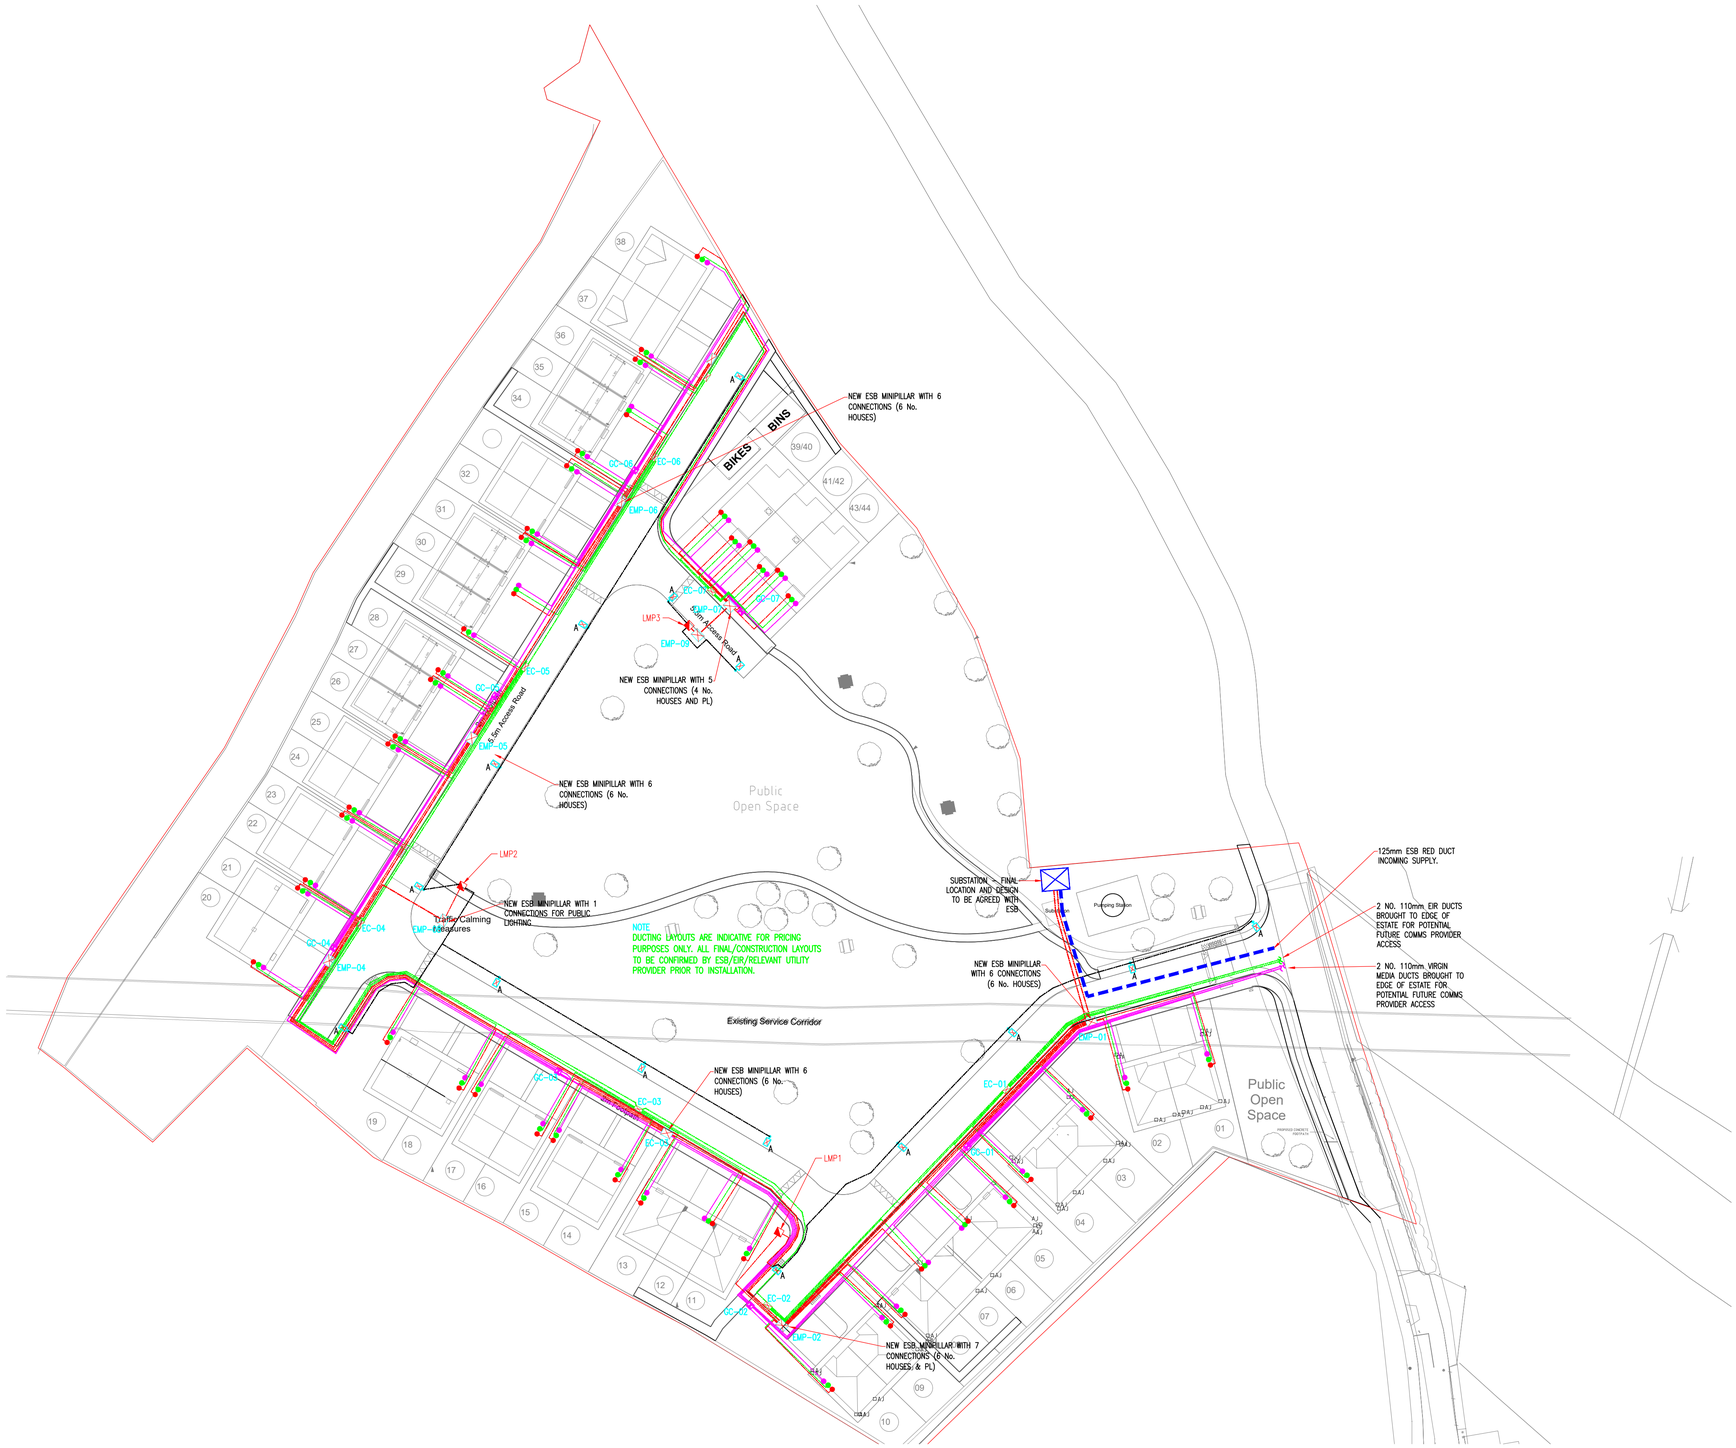

P2	18.06.25	ISSUED FOR PLANNING	GB	CDV
P1	12.03.24	ISSUED FOR PLANNING	SMcD	BS
P	08.04.22	ISSUED FOR INFROMATION	SMcD	BS
Rev.	Date	Revision Description	Drn.	Chk'd.

Renaissance Engineering Ltd.
2nd Floor, 67-70 Meath Street, Dublin 8, D08 XY53.
telephone: +353 (0) 1 675 0850
email: info@reneng.ie
web: www.renaissanceengineering.ie

Cavan County Council
Courthouse, Farnham Street, Cavan, H12 R6V2
telephone: +353 (0) 49 437 8300
email: info@cavancoco.ie
web: www.cavancoco.ie

Client:
CAVAN COUNTY COUNCIL

Architect:
WGG ARCHITECTS & SURVEYORS LTD

Job Title:
HOUSING DEVELOPMENT AT
LOIS NA RI MUNNILY COOTEHILL
CO, CAVAN

Drawing Title:
SITE SERVICES LAYOUT
GENERIC 2 DUCTING

Date:	Scale:		Job No.:	Drawing No.:	Revision:
02.03.22	1:500	@A1	22-110	SS-02	P2

Designer:	Checked:	Approved:	CAD Filename:
GB	BS	SM	22-110-SS-02.dwg

100mm - CAUTION WHEN SCALING ... CHECK!!

RE-A1 Title Block_Landscape_Vertical (Client Logo).dwg (Title Block Rev. 1.00 - Released: 23.03.21)